
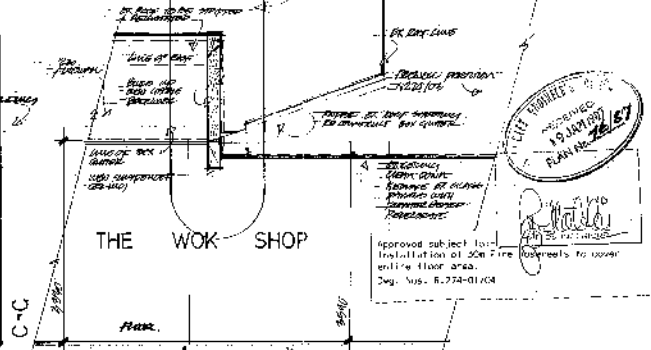
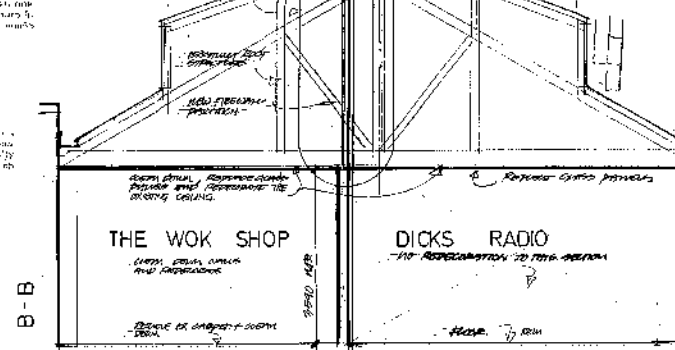


SEE R24/02 FOR DETAIL




SEE R24/02 FOR DETAIL

SEE R24/02 FOR DETAIL

SEE R24/02 FOR DETAIL

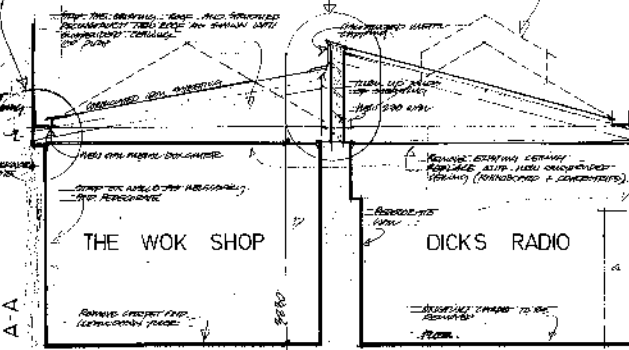

APPROVED SUBJECT TO:  
Installation of 50m fire hose reels to cover  
entire floor area.  
Sigs. Nos. 6.774-01/04

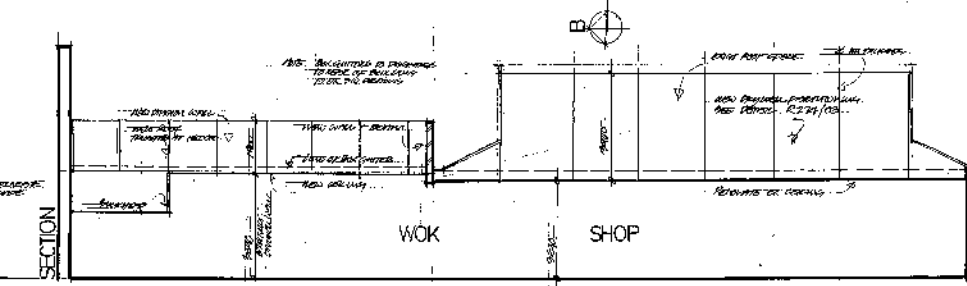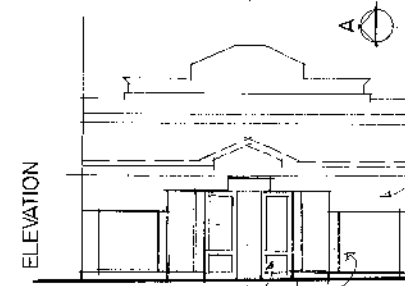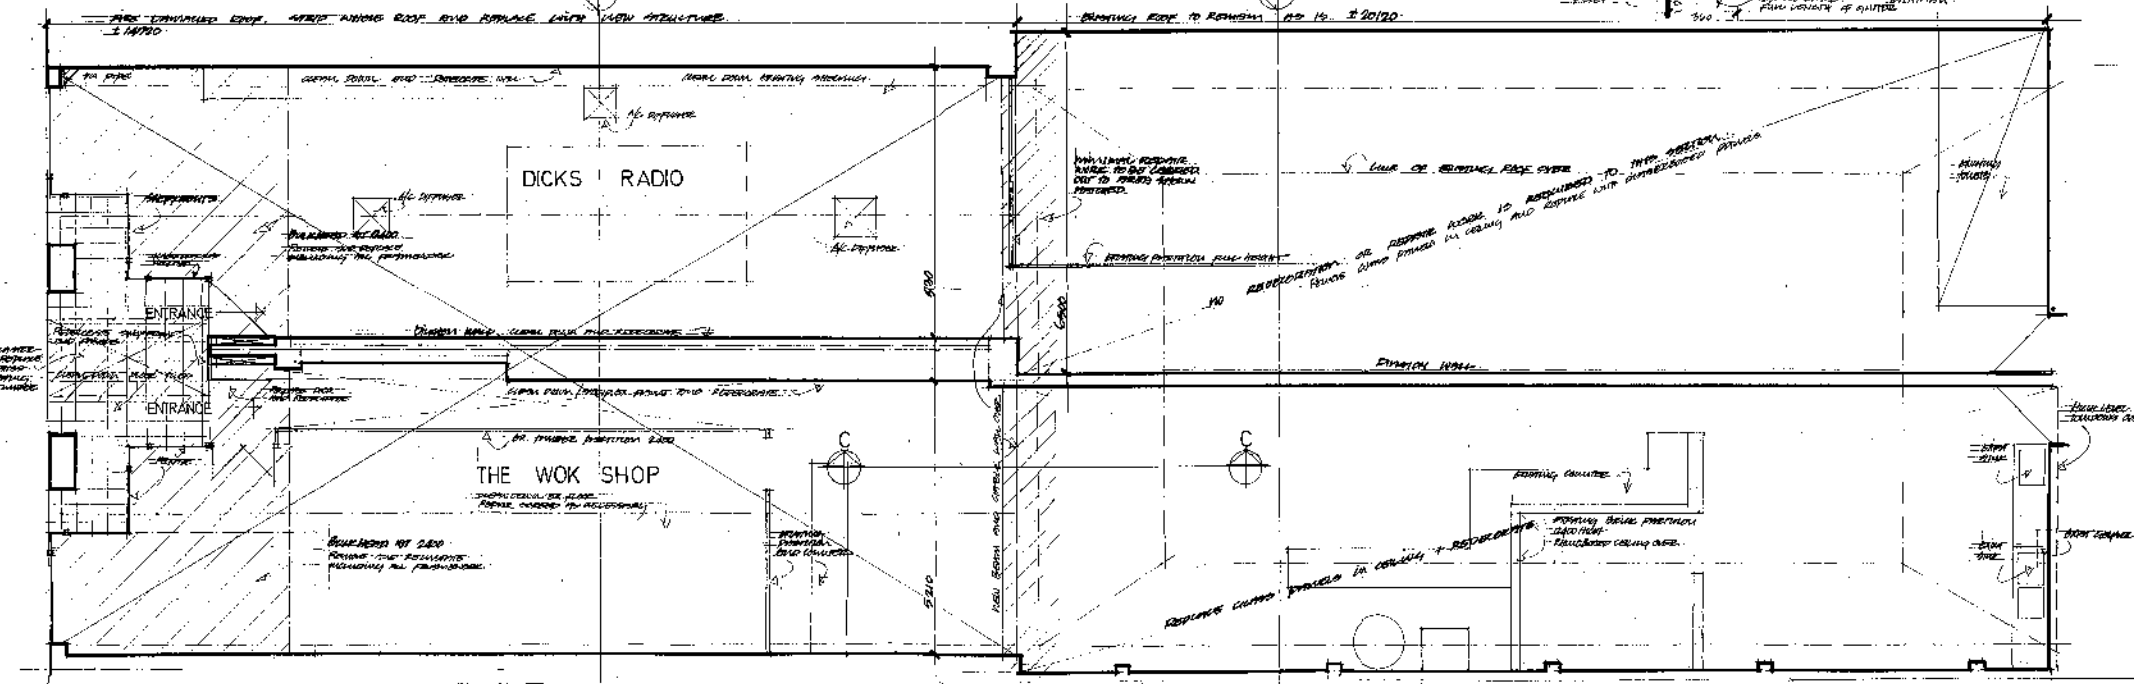

|                                                                                                                              |                                 |
|------------------------------------------------------------------------------------------------------------------------------|---------------------------------|
| <p>REID'S BUILDING<br/>LONGMARKET STREET<br/>MELBOURNE</p>                                                                   |                                 |
| <p>REPAIRS AND RENOVATIONS</p>                                                                                               |                                 |
| <p>Michael Dyer<br/>architect &amp; structural engineer<br/>45 temple street p.o. box 636<br/>pierremontsburg tel. 20321</p> |                                 |
| <p>scale: 1:50</p>                                                                                                           | <p>drawing no.<br/>R 274-01</p> |
| <p>date: JAN 87</p>                                                                                                          | <p>drawn by: [signature]</p>    |

